

A

BOUT YOUR HOUSE

CE33

CMHC GARBAGE BAG AIRFLOW TEST

There are times when you need to know the airflow from your furnace registers, bathroom exhaust fan or clothes dryer exhaust.

For example, if a house has one cold room in the winter, it is useful to find out if this is because your furnace isn't supplying enough warm air. If you installed a new bathroom exhaust fan, you could use the test to see if it is working properly.

This publication tells you how to do the *CMHC Garbage Bag Airflow Test*. The Test is a quick way to estimate airflow, by determining how long it takes to fill a common plastic garbage bag.

It is not a precise measurement, but it is a vast improvement over no measurement at all.

How to do the test

Here's how to use the test to measure airflow from a register or exhaust:

- Tape the mouth of the garbage bag to a bent coat hanger or a piece of cardboard to keep it open. (See Figure 1)
- Crush the bag flat.
- Place it over the register or exhaust hood.
- Count how many seconds it takes for the bag to inflate. (See Figure 2)
- Find the airflow from the register or exhaust from one of the following tables.

If you want to measure air going out, you can hold an inflated bag against an exhaust grill, and count how many seconds it takes for the bag to deflate. Deflation testing is not as accurate as inflation testing, but it is still a reasonable test. Low airflow is difficult to measure by deflation testing.

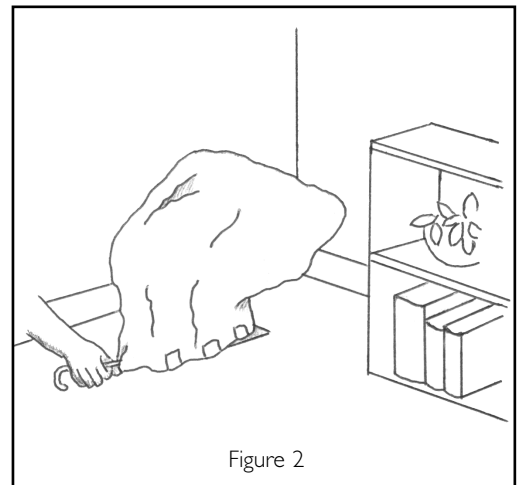


Figure 2

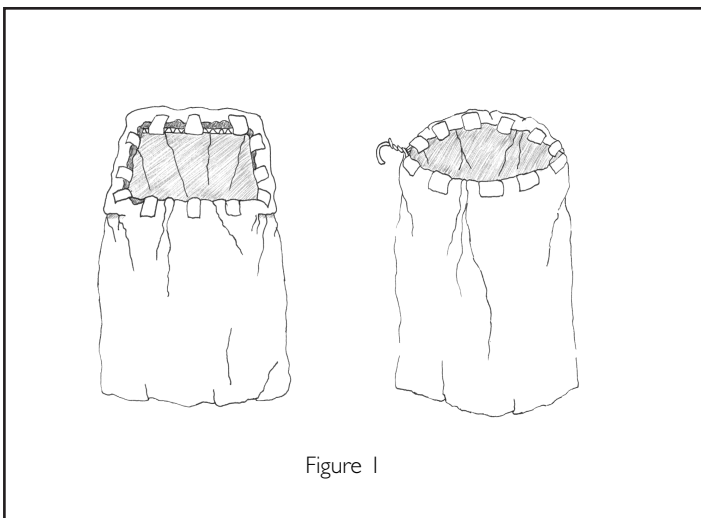


Figure 1



HOME TO CANADIANS
Canada

Small green garbage bag (Glad 66 x 91 cm)

Time to inflate	Flow of air into the bag
2 seconds	35 L/s (75 cfm)*
4 seconds	20 L/s (40 cfm)
10 seconds	10 L/s (20 cfm)

* L/s = litres per second; cfm = cubic feet a minute

For deflation, add a second. Therefore, 35 L/s would take about three seconds and 20 L/s about five seconds.

Big orange garbage bag (Glad 79 x 119 cm)

Time to inflate	Flow of air into the bag
2 seconds	100 L/s (210 cfm)*
4 seconds	50 L/s (105 cfm)
6 seconds	35 L/s (75 cfm)
10 seconds	20 L/s (40 cfm)

* L/s = litres per second; cfm = cubic feet a minute

Deflation times for the big orange bag are about the same as inflation times.

How to use the test

Using the examples mentioned above, if the measured airflow from a forced-air register is less than 10 L/s, the furnace is delivering only a small amount of heat to a room.

If you install a 100 cfm exhaust fan, and the fan inflates a standard bag in less than two seconds, you have the rated exhaust flow for the fan.

CMHC's Garbage Bag Airflow Test

is also useful if you have changed your heating or cooling systems, or if you have made major renovations to your house.

62288

Although this information product reflects housing experts' current knowledge, it is provided for general information purposes only. Any reliance or action taken based on the information, materials and techniques described are the responsibility of the user. Readers are advised to consult appropriate professional resources to determine what is safe and suitable in their particular case. CMHC assumes no responsibility for any consequence arising from use of the information, materials and techniques described.

To find more *About Your House* fact sheets plus a wide variety of information products, visit our Web site at

www.cmhc-schl.gc.ca

or contact:

Your local CMHC office

or

Canada Mortgage and Housing Corporation
700 Montreal Road
Ottawa ON K1A 0P7

Phone: 1 800 668-2642

Fax: 1 800 245-9274

©2001, Canada Mortgage and Housing Corporation
Printed in Canada
Produced by CMHC

02-01